Technical Data Sheet PipeBloc PCP Collars UIC of product-type: PCP

Issue: 4.1 Aug 2017



FIRE STOPPING & COMPARTMENTATION SYSTEMS

o-of nuallon Is Air Permeability vement Rigid Walls **Pipes Linear joints** lls Acoustic Rating **Trays Rigid Floors** es CE Cerification \ir Permoshili



CE Cerific Penetration Seals Movement Rigid W Metallic Pipes exible Walls le Trays Riaid **Plastic Pipes Air Dorm**



UAE Certificate of Compliance

ة دمي مل ا كويس عل ات ار ام ال ا قل و د کيل خ آدل ا قر از و ين دمل اعف دلل مَم اعل آمَد في قُل ا كيُّ مِلْ أَعِلْ آَتَ ارْبِيتَخَ مِلْ آَ دِ الْمِتَعَ أَ قَنْجِلْ يبور متل ا ده اعمو خربخل اتويب



CF5367

ETA 15-0489



CE-1121-CPR-JA5080











FSi Limited Westminster Industrial Estate Tamworth Road Measham DE12 7DS UK

www.fsiltd.com Email: technical@fsiltd.com Tel: +44 (0) 1530 515130 Fax: +44 (0) 1530 273564







Contents

Contents	Page
 Product Technical Data 	1 - 2
- Product Overview	
Performance Data - Wall	3 - 5
 100mm Rigid and Flexible Walls 150mm Rigid and Flexible Walls 	
 Performance Data - Floor 	6 - 10
- 150mm Rigid Floor	
 Performance Data - Batt 	11 - 16
- 100mm Rigid and Flexible Walls	
Extended Scope of Works	17











Product Technical Data

ETA 15-0489 CE-1121-CPR-JA5080

The Description of the Product

PipeBloc PCP Collars are designed and tested to seal service penetration apertures containing plastic and metallic pipes with insulation or cables. They are developed to provide a high volume expansion and pressure seal during a fire. The PipeBloc PCP Collars offers El120 and El240 tested results to EN1366-3, the maximum diameter available being 250mm. The ultra thin design of PipeBloc PCP Collars means the collar shell can give a depth of 30mm and 40mm ensuring that they can be installed into the tightest of locations. PipeBloc PCP Collars can be installed on flexible wall, rigid wall, rigid floor constructions and in Stopseal Batt seals.

PipeBloc PCP Collars is used around combustible pipes to form a penetration seal and to reinstate the fire resistance performance of wall and floor constructions, where they have been provided with apertures for the penetration of combustible pipe services.

PipeBloc PCP Collars includes an intumescent component incorporated into a mild steel case to close any gaps and to provide a closure of combustible pipes when heated to prevent the passage of fire.

PipeBloc PCP Collars are supplied in assembled form, without fixings. The collar is wrapped around the pipe at the soffit or both faces of walls, depending on application.

Intended Use

The specific elements of construction that the system PipeBloc PCP Collars may be used in as follows.

• Suitable for use with flexible walls with \geq 100mm minimum thickness, rigid wall with \geq 100mm minimum thickness and rigid floors with 150mm minimum thickness also within the Stopseal Batt system.

Key Product Points

- Allows thermal and mechanical movement of pipe.
- Halogen free, contains no asbestos or ceramic and is environmentally friendly.
- Ease of fixing to suit location 5 fixing types available.
- Not effected by fungus, vermin, rodents or moisture.
- Conditioned to Type X: -20°C to +70°C with accordance with EOTR 024 and Etag 026.









0



Product Technical Data

ETA 15-0489 CE-1121-CPR-JA5080

Description	Result	Test Standrads
Pipe Diameter	32mm, 40mm, 50mm, 55mm, 63mm, 75mm, 82mm, 90mm, 100mm, 110mm, 125mm, 140mm, 160mm, 200mm and 250mm	
Plastic types	PVC-U, PVC-C, ABS, SAN + PVC, PE-HD, PE, PP	
Fire Resistance Rigid Floors	El 240 - Floor (underside)	EN 1366-3:2009
Fire Resistance Flexible & Rigid Walls	El 120 - Wall (one each side)	EN 1366-3:2009
Expansion Rate	20:1	EOTA TR 024
Expansion Pressure N/mm ²	1.30	EOTA TR 024
Working Temperature	-20°C to +120°C	
Colour / Appearance	Green Steel - 3 Fixing Tabs	
Fixing Detail	 3 No 60mm x 6mm Expanding Anchors Rigid Floors 3 No Size 70 Wood Screws Rigid Walls 3 No 65 mm Spider Fixings Flexible Walls 3 No 35mm Tap in Fixings Rigid Wall and Floors 3 No 80mm Pig tails for Batt installation 	
Expected Shelf Life	N/A	N/A

Installation

Ensure that the aperture and services in question are tested with PipeBloc PCP Collars, and the site conditions are within the application specification. An annular space needs to be present around the service to apply sufficient installation depth of Pyrocoustic Sealant.

All services and apertures need to be clean and clear of all dust and loose particles. The aperture temperature needs to at 5°C or above at time of installation.

<u>Upon installation make sure that you fill in the annular gap around the pipe maximum 10mm annular</u>, install the PipeBloc PCP Collars around the pipe and fix the collar to the wall or floor with the recommended fixings.











Performance Data - Walls

ETA 15-0489 CE-1121-CPR-JA5080

Substrates

The walls shall be a minimum of **100mm thick**. Drywalls shall comprise a minimum of 2 layers of 'Type F' Gypsum board on both faces, with minimum 50mm studs. Masonary / Concrete walls shall have a minimum density for concrete or brick of 780kg/m³ and for aerated concrete blocks of 600kg/m³. All walls shall have at least the same fire resistance as that required for the sealing system.

Service support requirements

Services should be rigidly supported via steel angles, hangers or channels, not further than 400mm from the surface of the sealing system on both faces on both faces of the wall and the top side of the floor unless specified otherwise in the performance data.

Terminology

Fire performance in accordance with EN1366-3, EN1366-4, Classification 13501-2:2007 + A1:2009, ETAG-026, Air Permeability EN1026, Sound EN10140. Fire resistance classes are: E = Integrity, the product can withstand the fire from the non-fire side, I =Insulation, the product can withstand the temperature travelling down the service, U/U = Uncapped inside and outside the furnace, U/C = Uncapped inside and Capped outside the furnace, C/U = Capped inside and Uncapped outside the furnace.

FLEXIBLE OR RIGID WALL

PipeBloc PCP Collars, face fixed to both sides of the wall with a minimum thickness of 100mm PVC Pipes.					
Penetration Specification	Penetration Specification Collar Reference				
PVC Pipe 32mm ø 1.8mm wall thickness.	32 mm PipeBloc PCP Collars				
PVC Pipe 40mm ø 1.8mm wall thickness.	40 mm PipeBloc PCP Collars				
PVC Pipe 50mm ø 1.8mm wall thickness.	50 mm PipeBloc PCP Collars				
PVC Pipe 55mm ø 2.3 - 3.0mm wall thickness.	55 mm PipeBloc PCP Collars				
PVC Pipe 63mm ø 2.3 - 3.0mm wall thickness.	63 mm PipeBloc PCP Collars				
PVC Pipe 75mm ø 3.1 - 4.8mm wall thickness.	75 mm PipeBloc PCP Collars				
PVC Pipe 82mm ø 3.1 - 4.8mm wall thickness.	82 mm PipeBloc PCP Collars	10	EI 120 U/C		
PVC Pipe 90mm 4.2 - 7.4mm wall thickness.	90 mm PipeBloc PCP Collars				
PVC Pipe 100mm ø 4.2 - 7.4mm wall thickness.	100 mm PipeBloc PCP Collars				
PVC Pipe 110mm ø 4.2 - 7.2mm wall thickness.	110 mm PipeBloc PCP Collars				
PVC Pipe 125mm ø 6.0mm wall thickness.	125 mm PipeBloc PCP Collars				
PVC Pipe 140mm ø 6.1 - 7.5mm wall thickness.	140 mm PipeBloc PCP Collars				
PVC Pipe 160mm ø 6.2 - 9.5mm wall thickness.	160 mm PipeBloc PCP Collars				











Performance Data - Walls

ETA 15-0489 CE-1121-CPR-JA5080

FLEXIBLE OR RIGID WALL

PipeBloc PCP Collars, face fixed to both side of the wall with a minimum thickness of 100mm PP Pipes.					
Penetration Specification Collar Reference Annulus Space (mm					
PP Pipe 32mm ø 2.9mm wall thickness.	32 mm PipeBloc PCP Collars				
PP Pipe 40mm ø 2.9mm wall thickness.	40 mm PipeBloc PCP Collars				
PP Pipe 50mm ø 2.9mm wall thickness.	50 mm PipeBloc PCP Collars				
PP Pipe 55mm ø 2.9 - 4.4mm wall thickness.	55 mm PipeBloc PCP Collars				
PP Pipe 63mm ø 2.9 - 4.4mm wall thickness.	63 mm PipeBloc PCP Collars				
PP Pipe 75mm ø 2.8 - 6,7mm wall thickness.	75 mm Ø 2.8 - 6,7mm wall thickness. 75 mm PipeBloc PCP Collars				
PP Pipe 82mm ø 2.8 - 6.7mm wall thickness.	82 mm PipeBloc PCP Collars	10	EI 120 U/C		
PP Pipe 90mm ø 2.7 - 10.0mm wall thickness.	90 mm PipeBloc PCP Collars				
PP Pipe 100mm ø 2.7 - 10.0mm wall thickness.	100 mm PipeBloc PCP Collars				
PP Pipe 110mm ø 2.7 - 10.0mm wall thickness.	110 mm PipeBloc PCP Collars				
PP Pipe 125mm ø 3.1mm wall thickness.	125 mm PipeBloc PCP Collars				
PP Pipe 140mm ø 3.5 - 8.0mm wall thickness.	140 mm PipeBloc PCP Collars				
PP Pipe 160mm ø 4.0 -14.6mm wall thickness.	160 mm PipeBloc PCP Collars				

PipeBloc PCP Collars, face fixed to both sides of the wall with a minimum thickness of 100mm PE Pipes.					
Penetration Specification	Collar Reference	Annulus Space (mm)	Classification		
PE Pipe 32mm ø 2.9mm wall thickness.	32 mm PipeBloc PCP Collars				
PE Pipe 40mm ø 2.9mm wall thickness.	40 mm PipeBloc PCP Collars				
PE Pipe 50mm ø 2.9mm wall thickness.	50 mm PipeBloc PCP Collars				
PE Pipe 55mm ø 2.9 - 4.4mm wall thickness.	55 mm PipeBloc PCP Collars				
PE Pipe 63mm ø 2.9 - 4.4mm wall thickness.	63 mm PipeBloc PCP Collars				
PE Pipe 75mm ø 2.8 - 6.7mm wall thickness.	75 mm PipeBloc PCP Collars				
PE Pipe 82mm ø 2.8 - 6.7mm wall thickness.	82 mm PipeBloc PCP Collars	10	EI 120 U/C		
PE Pipe 90mm ø 2.7 - 10.0mm wall thickness.	90 mm PipeBloc PCP Collars				
PE Pipe 100mm ø 2.7 - 10.0mm wall thickness.	100 mm PipeBloc PCP Collars				
PE Pipe 110mm ø 2.7 - 10.0mm wall thickness.	110 mm PipeBloc PCP Collars				
PE Pipe 125mm ø 3.1mm wall thickness.	125 mm PipeBloc PCP Collars				
PE Pipe 140mm ø 3.9 - 5.8mm wall thickness.	140 mm PipeBloc PCP Collars				
PE Pipe 160mm ø 4.9 - 9.5mm wall thickness.	160 mm PipeBloc PCP Collars				











Performance Data - Walls

ETA 15-0489 CE-1121-CPR-JA5080

RIGID WALL

PipeBloc PCP Collars, face fixed to both sides of the Rigid Wall with a minimum thickness of 100mm PP Pipes.						
Penetration Specification	Collar Reference	Annulus Space (mm)	Classification			
PP Pipe 110mm ø 2.7mm wall thickness.	110 mm PipeBloc PCP Collars		EI 120 U/U			
PP Pipe 160mm ø 4.0mm wall thickness.	160 mm PipeBloc PCP Collars	10	EI 120 U/U			
PP Pipe 250mm ø 6.2mm wall thickness.	250 mm PipeBloc PCP Collars		EI 120 U/C			











ETA 15-0489 CE-1121-CPR-JA5080

Substrates

The floors shall be a minimum of **150mm thick**. Masonary / Concrete floors shall have a minimum density for concrete or brick of 780kg/m³ and for aerated concrete blocks of 600kg/m³. All floors shall have at least the same fire rating as that required for the Sealing system.

Service support requirements

Services should be rigidly supported via steel angles, hangers or channels, not further than 400mm from the surface of the sealing system on both faces unless specified otherwise in the performance data.

Terminology

Fire performance in accordance with EN1366-3, EN1366-4, Classification 13501-2:2007 + A1:2009, ETAG-026, Air Permeability EN1026, Sound EN10140. Fire resistance classes are: E = Integrity, the product can withstand the fire from the non-fire side, I =Insulation, the product can withstand the temperature travelling down the service, U/U = Uncapped inside and outside the furnace, U/C = Uncapped inside and Capped outside the furnace, C/U = Capped inside and Uncapped outside the furnace.

RIGID FLOOR

PipeBloc PCP Collars, face fixed on the underside of Rigid Floor with a minimum thickness of 150mm PVC Pipes.					
Penetration Specification	Collar Reference	Annulus Space (mm)	Classification		
PVC Pipe 32mm ø 1.8mm wall thickness.	32 mm PipeBloc PCP Collars				
PVC Pipe 40mm ø 1.8mm wall thickness.	40 mm PipeBloc PCP Collars				
PVC Pipe 50mm ø 1.8mm wall thickness.	50 mm PipeBloc PCP Collars				
PVC Pipe 55mm ø 2.3 - 3.0mm wall thickness.	55 mm PipeBloc PCP Collars				
PVC Pipe 63mm ø 2.3 - 3.0mm wall thickness.	63 mm PipeBloc PCP Collars				
PVC Pipe 75mm ø 3.1 - 4.8mm wall thickness.	75 mm PipeBloc PCP Collars				
PVC Pipe 82mm ø 3.1 - 4.8mm wall thickness.	3.1 - 4.8mm wall thickness. 82 mm PipeBloc PCP Collars		EI 240 U/C		
PVC Pipe 90mm 4.2 - 7.4mm wall thickness.	90 mm PipeBloc PCP Collars				
PVC Pipe 100mm ø 4.2 - 7.4mm wall thickness.	100 mm PipeBloc PCP Collars				
PVC Pipe 110mm ø 4.2 - 7.2mm wall thickness.	110 mm PipeBloc PCP Collars				
PVC Pipe 125mm ø 6.0mm wall thickness.	125 mm PipeBloc PCP Collars				
PVC Pipe 140mm ø 6.1 - 7.5mm wall thickness.	140 mm PipeBloc PCP Collars				
PVC Pipe 160mm ø 6.2 - 9.5mm wall thickness.	160 mm PipeBloc PCP Collars				













ETA 15-0489 CE-1121-CPR-JA5080

RIGID FLOOR

PipeBloc PCP Collars, face fixed on the underside of Rigid Floor with a minimum thickness of 150mm PP Pipes.						
Penetration Specification	Penetration Specification Collar Reference					
PP Pipe 32mm ø 2.9mm wall thickness.	32 mm PipeBloc PCP Collars					
PP Pipe 40mm ø 2.9mm wall thickness.	40 mm PipeBloc PCP Collars					
PP Pipe 50mm ø 2.9mm wall thickness.	50 mm PipeBloc PCP Collars					
PP Pipe 55mm ø 2.9 - 4.4mm wall thickness.	55 mm PipeBloc PCP Collars					
PP Pipe 63mm ø 2.9 - 4.4mm wall thickness.	63 mm PipeBloc PCP Collars					
PP Pipe 75mm ø 2.8 - 6,7mm wall thickness.	wall thickness. 75 mm PipeBloc PCP Collars					
PP Pipe 82mm ø 2.8 - 6.7mm wall thickness.	82 mm PipeBloc PCP Collars	10	EI 240 U/C			
PP Pipe 90mm ø 2.7 - 10.0mm wall thickness.	90 mm PipeBloc PCP Collars					
PP Pipe 100mm ø 2.7 - 10.0mm wall thickness.	100 mm PipeBloc PCP Collars					
PP Pipe 110mm ø 2.7 - 10.0mm wall thickness.	110 mm PipeBloc PCP Collars					
PP Pipe 125mm ø 3.1mm wall thickness.	125 mm PipeBloc PCP Collars					
PP Pipe 140mm ø 3.5 - 8.0mm wall thickness.	140 mm PipeBloc PCP Collars					
PP Pipe 160mm ø 4.0 -14.6mm wall thickness.	160 mm PipeBloc PCP Collars					

PipeBloc PCP Collars, face fixed on the underside of Rigid Floor with a minimum thickness of 150mm PE Pipes.

Penetration Collar Reference		Annulus Space (mm)	Classification
PE Pipe 32mm ø 2.9mm wall thickness.	32 mm PipeBloc PCP Collars		
PE Pipe 40mm ø 2.9mm wall thickness.	40 mm PipeBloc PCP Collars		
PE Pipe 50mm ø 2.9mm wall thickness.	50 mm PipeBloc PCP Collars		
PE Pipe 55mm ø 2.9 - 4.4mm wall thickness.	55 mm PipeBloc PCP Collars		
PE Pipe 63mm ø 2.9 - 4.4mm wall thickness.	63 mm PipeBloc PCP Collars	10	
PE Pipe 75mm ø 2.8 - 6.7mm wall thickness.	75 mm PipeBloc PCP Collars		EI 240 U/C
PE Pipe 82mm ø 2.8 - 6.7mm wall thickness.	82 mm PipeBloc PCP Collars		
PE Pipe 90mm ø 2.7 - 10.0mm wall thickness.	90 mm PipeBloc PCP Collars		
PE Pipe 100mm ø 2.7 - 10.0mm wall thickness.	100 mm PipeBloc PCP Collars		
PE Pipe 110mm ø 2.7 - 10.0mm wall thickness.	110 mm PipeBloc PCP Collars		
PE Pipe 125mm ø 3.1mm wall thickness.	125 mm PipeBloc PCP Collars		
PE Pipe 140mm ø 3.9 - 5.8mm wall thickness.	140 mm PipeBloc PCP Collars		
PE Pipe 160mm ø 4.9 - 9.5mm wall thickness.	160 mm PipeBloc PCP Collars		











ETA 15-0489 CE-1121-CPR-JA5080

RIGID FLOOR

PipeBloc PCP Collars, face fixed on the underside of Rigid Floor with a minimum thickness of 150mm PP Pipes.						
Penetration Specification	Annulus Space (mm)	Classification				
PP Pipe 110mm ø 2.7mm wall thickness.	110mm PipeBloc PCP Collars	10	EI 120 U/U			
PP Pipe 160mm ø 4.0mm wall thickness.	160mm PipeBloc PCP Collars	10	EI 120 C/U			

SILVERSEAL HS COMPOUND

Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification					
		PE Pipe 32mm Ø 2.9mm Wall thickness.										
		PE Pipe 40mm Ø 2.9mm Wall thickness.	40mm PipeBloc PCP Collars									
		PE Pipe 50mm Ø 2.9mm Wall thickness.	50mm PipeBloc PCP Collars									
		PE Pipe 55mm Ø 2.9mm - 4.4mm Wall thickness.	55mm PipeBloc PCP Collars									
		PE Pipe 63mm Ø 2.9mm - 4.4mm Wall thickness.	63mm PipeBloc PCP Collars	Cluster Formation U/C of Pipes with Omm separation.	Fixed							
		PE Pipe 75mm Ø 2.8mm - 6.7mm Wall thickness.	75mm PipeBloc PCP Collars			Fixed on both						
750mm wide by 1400mm	100mm thick Silverseal HS	PE Pipe 82mm Ø 2.8mm - 6.7mm Wall thickness.	82mm PipeBloc PCP Collars		Formation sides of	ides of						
high	Compound.	PE Pipe 90mm Ø 2.7mm - 10.0mm Wall thickness.	90mm PipeBloc PCP Collars			separation. anchor						
		PE Pipe 100mm Ø 2.7mm - 10.0mm Wall thickness.	100mm PipeBloc PCP Collars			πxing.						
	· · · · · · · · · · · · · · · · · · ·	110mm PipeBloc PCP Collars										
		PE Pipe 125mm Ø 3.1mm Wall thickness.	125mm PipeBloc PCP Collars	-								
		PE Pipe 140mm Ø 3.9mm - 5.8mm Wall thickness.	140mm PipeBloc PCP Collars									
		PE Pipe 160mm Ø 4.9mm - 9.5mm Wall thickness.	160mm PipeBloc PCP Collars									











ETA 15-0489 CE-1121-CPR-JA5080

SILVERSEAL HS COMPOUND

Pi	PipeBloc PCP Collars, fixed to the underside of a Silverseal HS Compound floor with a minimum thickness of 100mm PP Pipes.														
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification								
		PP Pipe 32mm Ø 2.9mm Wall thick- ness.	32mm PipeBloc PCP Collars												
		PP Pipe 40mm Ø 2.9mm Wall thick- ness.	40mm PipeBloc PCP Collars												
		PP Pipe 50mm Ø 2.9mm Wall thick- ness.	50mm PipeBloc PCP Collars												
		PP Pipe 55mm Ø 2.9mm - 4.4mm Wall thickness.	55mm PipeBloc PCP Collars												
		PP Pipe 63mm Ø 2.9mm - 4.4mm Wall thickness.	63mm PipeBloc PCP Collars		Cluster										
750mm		PP Pipe 75mm Ø 2.8mm - 6.7mm Wall thickness.	75mm PipeBloc PCP Collars	U/C of Pipes with 0mm		Fixed on	Fixed on both sides								
wide by 1400mm	100mm thick Silverseal HS Compound.	PP Pipe 82mm Ø 2.8mm - 6.7mm Wall thickness.	82mm PipeBloc PCP Collars		U/C	U/C	U/C of Pipes	of Pipes	of Pipes	of Pipes of	of wall with a 60mm	a 60mm	a 60mm		EI 120 U/C
high	compound.	PP Pipe 90mm Ø 2.7mm - 10.0mm Wall thickness.	90mm PipeBloc PCP Collars		separation.	anchor									
		PP Pipe 100mm Ø 2.7mm - 10.0mm Wall thickness.	100mm PipeBloc PCP Collars												
		PP Pipe 110mm Ø 2.7mm - 10.0mm Wall thickness.	110mm PipeBloc PCP Collars												
	PP Pipe 125mm Ø 3.1mm Wall thickness. PP Pipe 140mm Ø 3.5mm - 8.0mm Wall thickness. PP Pipe 160mm Ø 4.0mm - 14.6mm Wall thickness.	125mm PipeBloc PCP Collars													
			140mm PipeBloc PCP Collars												
		•	160mm PipeBloc PCP Collars												











ETA 15-0489 CE-1121-CPR-JA5080

SILVERSEAL HS COMPOUND

PipeBloc PCP Collars, fixed to the underside of a Silverseal HS Compound floor with a minimum thickness of 100mm PVC-U & PVC-C Pipes.									
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification		
		PVC Pipe 32mm Ø 1.8mm Wall thickness.	32mm PipeBloc PCP Collars						
		PVC Pipe 40mm Ø 1.8mm Wall thickness.	40mm PipeBloc PCP Collars						
		PVC Pipe 50mm Ø 1.8mm Wall thickness.	50mm PipeBloc PCP Collars						
		PVC Pipe 55mm Ø 2.3mm - 3mm Wall thickness.	55mm PipeBloc PCP Collars						
		PVC Pipe 63mm Ø 2.3mm - 3mm Wall thickness.	63mm PipeBloc PCP Collars						
750mm		PVC Pipe 75mm Ø 3.1mm - 4.8mm Wall thickness.	75mm PipeBloc PCP Collars		Cluster	Fixed on both sides of wall with a 60mm			
wide by 1400mm	100mm thick Silverseal HS Compound.	PVC Pipe 82mm Ø 3.1mm - 4.8mm Wall thickness.	82mm PipeBloc PCP Collars	U/C	Formation of Pipes with 0mm		a 60mm	EI 120 U/C	
high	compound.	PVC Pipe 90mm Ø 4.2mm - 7.4mm Wall thickness.	90mm PipeBloc PCP Collars		separation.	anchor fixing.			
		PVC Pipe 100mm Ø 4.2mm - 7.4mm Wall thickness.	100mm PipeBloc PCP Collars						
		PVC Pipe 110mm Ø 4.2mm - 7.4mm Wall thickness.	110mm PipeBloc PCP Collars						
		PVC Pipe 125mm Ø 6mm Wall thickness.	125mm PipeBloc PCP Collars						
		PVC Pipe 140mm Ø 6.1mm - 7.5mm Wall thickness.	140mm PipeBloc PCP Collars						
		PVC Pipe 160mm Ø 6.2mm - 9.5mm Wall thickness.	160mm PipeBloc PCP Collars						











ETA 15-0489 CE-1121-CPR-JA5080

Substrates

The walls shall be a minimum of **100mm thick**. Drywalls shall comprise a minimum of 2 layers of 'Type F' Gypsum board on both faces, with minimum 50mm studs. Masonary / Concrete walls shall have a minimum density for concrete or brick of 780kg/m³ and for aerated concrete blocks of 600kg/m³. All walls shall have at least the same fire resistance as that required for the sealing system.

Service support requirements

Services should be rigidly supported via steel angles, hangers or channels, not further than 400mm from the surface of the sealing system on both faces of the wall and the top side of the floor unless specified otherwise in the performance data.

Terminology

Fire performance in accordance with EN1366-3, EN1366-4, Classification 13501-2:2007 + A1:2009, ETAG-026, Air Permeability EN1026, Sound EN10140. Fire resistance classes are: E = Integrity, the product can withstand the fire from the non-fire side, I =Insulation, the product can withstand the temperature travelling down the service, U/U = Uncapped inside and outside the furnace, U/C = Uncapped inside and Capped outside the furnace, C/U = Capped inside and Uncapped outside the furnace.

Pi	PipeBloc PCP Collars, face fixed onto Stopseal Batt in Flexible Wall with a minimum thickness of 100mm PE, ABS & SAN+PVC Pipes								
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification		
		PE Pipe 32mm Ø 2.9mm Wall thickness.	.9mm Wall thickness. 32mm PipeBloc PCP Collars						
		PE Pipe 40mm Ø 2.9mm Wall thickness.	40mm PipeBloc PCP Collars				EI 120 U/C		
		PE Pipe 50mm Ø 2.9mm Wall thickness.	50mm PipeBloc PCP Collars						
		PE Pipe 55mm Ø 2.9mm - 4.4mm Wall thickness.	55mm PipeBloc PCP Collars						
		PE Pipe 63mm Ø 2.9mm - 4.4mm Wall thickness.	63mm PipeBloc PCP Collars			Fixed			
750mm	Double layer	PE Pipe 75mm Ø 2.8mm - 6.7mm Wall thickness.	75mm PipeBloc PCP Collars		Cluster Formation of Pipes with 0mm	on both sides of wall with a			
wide by 1200mm	of 50mm thick 140kg/ m ³ Stopseal	PE Pipe 82mm Ø 2.8mm - 6.7mm Wall thickness.	82mm PipeBloc PCP Collars	U/C			EI 120 U/C		
high	Coated Batt.	PE Pipe 90mm Ø 2.7mm - 10.0mm Wall thickness.	90mm PipeBloc PCP Collars		separation.	80mm Pig Tail			
		PE Pipe 100mm Ø 2.7mm - 10.0mm Wall thickness.	100mm PipeBloc PCP Collars			Screw.			
		PE Pipe 110mm Ø 2.7mm - 10.0mm Wall thickness.	110mm PipeBloc PCP Collars						
		PE Pipe 125mm Ø 3.1mm Wall thick- ness.	125mm PipeBloc PCP Collars						
		PE Pipe 140mm Ø 3.9mm - 5.8mm Wall thickness.	140mm PipeBloc PCP Collars						
		PE Pipe 160mm Ø 4.9mm - 9.5mm Wall thickness.	160mm PipeBloc PCP Collars						











ETA 15-0489 CE-1121-CPR-JA5080

Pip	PipeBloc PCP Collars, face fixed onto Stopseal Batt in Flexible Wall with a minimum thickness of 100mm PE, ABS & SAN+PVC Pipes									
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification			
		PE Pipe 32mm Ø 2.9mm Wall thick- ness.	32mm PipeBloc PCP Collars							
		PE Pipe 40mm Ø 2.9mm Wall thick- ness.	40mm PipeBloc PCP Collars							
		PE Pipe 50mm Ø 2.9mm Wall thick- ness.	50mm PipeBloc PCP Collars				h of th EI 120 U/C m il			
		PE Pipe 55mm Ø 2.9mm - 4.4mm Wall thickness.	55mm PipeBloc PCP Collars			Collar Fixing Classificatio				
		PE Pipe 63mm Ø 2.9mm - 4.4mm Wall thickness.	63mm PipeBloc PCP Collars		Cluster					
		PE Pipe 75mm Ø 2.8mm - 6.7mm Wall thickness.	75mm PipeBloc PCP Collars							
750mm	Pattress installation	PE Pipe 82mm Ø 2.8mm - 6.7mm Wall thickness.	82mm PipeBloc PCP Collars							
wide by 1200mm	of 50mm thick 140kg/	PE Pipe 90mm Ø 2.7mm - 10.0mm Wall thickness.	90mm PipeBloc PCP Collars	U/C	Formation of Pipes with Omm		EI 120 U/C			
high	m ³ Stopseal Coated Batt.	PE Pipe 100mm Ø 2.7mm - 10.0mm Wall thickness.	100mm PipeBloc PCP Collars		separation.	Pig Tail				
		PE Pipe 110mm Ø 2.7mm - 10.0mm Wall thickness.	110mm PipeBloc PCP Collars			Collar Class Fixing Class Fixed Image: State of the stat				
		PE Pipe 125mm Ø 3.1mm Wall thick- ness.	125mm PipeBloc PCP Collars							
		PE Pipe 140mm Ø 3.9mm - 5.8mm Wall thickness.	140mm PipeBloc PCP Collars							
		PE Pipe 160mm Ø 4.9mm - 9.5mm Wall thickness.	160mm PipeBloc PCP Collars							











ETA 15-0489 CE-1121-CPR-JA5080

	PipeBloc PCP Collars, face fixed onto Stopseal Batt in Flexible Wall with a minimum thickness of 100mm PP Pipes.									
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification			
		PP Pipe 32mm Ø 2.9mm Wall thick- ness.	32mm PipeBloc PCP Collars							
		PP Pipe 40mm Ø 2.9mm Wall thick- ness.	40mm PipeBloc PCP Collars							
		PP Pipe 50mm Ø 2.9mm Wall thick- ness.	50mm PipeBloc PCP Collars							
		PP Pipe 55mm Ø 2.9mm - 4.4mm Wall thickness.	55mm PipeBloc PCP Collars							
		PP Pipe 63mm Ø 2.9mm - 4.4mm Wall thickness.	63mm PipeBloc PCP Collars							
		PP Pipe 75mm Ø 2.8mm - 6.7mm Wall thickness.	75mm PipeBloc PCP Collars		Cluster Formation of Pipes with	Fixed on both				
750mm	Double layer	PP Pipe 82mm Ø 2.8mm - 6.7mm Wall thickness.	82mm PipeBloc PCP Collars							
wide by 1200mm	of 50mm thick 140kg/ m ³ Stopseal	PP Pipe 90mm Ø 2.7mm - 10.0mm Wall thickness.	90mm PipeBloc PCP Collars	U/C		of Pipes with wa	sides of wall with a 80mm	EI 120 U/C		
high	Coated Batt.	PP Pipe 100mm Ø 2.7mm - 10.0mm Wall thickness.	100mm PipeBloc PCP Collars		separation.	Pig Tail Screw.				
		PP Pipe 110mm Ø 2.7mm - 10.0mm Wall thickness.	110mm PipeBloc PCP Collars							
		PP Pipe 125mm Ø 3.1mm Wall thick- ness.	125mm PipeBloc PCP Collars							
		PP Pipe 140mm Ø 3.5mm - 8.0mm Wall thickness.	140mm PipeBloc PCP Collars							
		PP Pipe 160mm Ø 4.0mm - 14.6mm Wall thickness.	160mm PipeBloc PCP Collars							











ETA 15-0489 CE-1121-CPR-JA5080

PipeBloc PCP Collars, face fixed onto Stopseal Batt in Flexible Wall with a minimum thickness of 100mm PP Pipes								
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification	
		PP Pipe 32mm Ø 2.9mm Wall thickness.	32mm PipeBloc PCP Collars				EI 120 U/C	
		PP Pipe 40mm Ø 2.9mm Wall thickness.	40mm PipeBloc PCP Collars					
		PP Pipe 50mm Ø 2.9mm Wall thickness.	50mm PipeBloc PCP Collars					
		PP Pipe 55mm Ø 2.9mm - 4.4mm Wall thickness.	55mm PipeBloc PCP Collars			wall with		
		PP Pipe 63mm Ø 2.9mm - 4.4mm Wall thickness.	63mm PipeBloc PCP Collars					
		PP Pipe 75mm Ø 2.8mm - 6.7mm Wall thickness.	75mm PipeBloc PCP Collars					
750mm	Pattress installation	PP Pipe 82mm Ø 2.8mm - 6.7mm Wall thickness.	82mm PipeBloc PCP Collars		Cluster	on both		
wide by 1200mm	of 50mm thick 140kg/	PP Pipe 90mm Ø 2.7mm - 10.0mm Wall thickness.	90mm PipeBloc PCP Collars	U/C	Formation of Pipes with 0mm	wall with	wall with	EI 120 U/C
high	m ³ Stopseal Coated Batt.	PP Pipe 100mm Ø 2.7mm - 10.0mm Wall thickness.	100mm PipeBloc PCP Collars		separation.	Pig Tail Screw.		
		PP Pipe 110mm Ø 2.7mm - 10.0mm Wall thickness.	110mm PipeBloc PCP Collars			on both sides of wall with a 80mm Pig Tail		
		PP Pipe 125mm Ø 3.1mm Wall thickness.	125mm PipeBloc PCP Collars					
		PP Pipe 140mm Ø 3.5mm - 8.0mm Wall thickness.	140mm PipeBloc PCP Collars					
		PP Pipe 160mm Ø 4.0mm - 14.6mm Wall thickness.	160mm PipeBloc PCP Collars					











ETA 15-0489 CE-1121-CPR-JA5080

P	PipeBloc PCP Collars, face fixed onto Stopseal Batt in Flexible Wall with a minimum thickness of 100mm PVC-U & PVC-C Pipes								
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification		
		PVC Pipe 32mm Ø 1.8mm Wall thick- ness.	32mm PipeBloc PCP Collars						
		PVC Pipe 40mm Ø 1.8mm Wall thick- ness.	40mm PipeBloc PCP Collars				Ked both des wall th a mm Tail		
		PVC Pipe 50mm Ø 1.8mm Wall thick- ness.	50mm PipeBloc PCP Collars						
		PVC Pipe 55mm Ø 2.3mm - 3mm Wall thickness.	55mm PipeBloc PCP Collars						
		PVC Pipe 63mm Ø 2.3mm - 3mm Wall thickness.	63mm PipeBloc PCP Collars						
		PVC Pipe 75mm Ø 3.1mm - 4.8mm Wall thickness.	75mm PipeBloc PCP Collars			Fixed on both			
750mm	Double layer	PVC Pipe 82mm Ø 3.1mm - 4.8mm Wall thickness.	82mm PipeBloc PCP Collars		Cluster				
wide by 1200mm	of 50mm thick 140kg/ m ³ Stopseal	PVC Pipe 90mm Ø 4.2mm - 7.4mm Wall thickness.	90mm PipeBloc PCP Collars	U/C	Formation of Pipes	of Pines of W	of wall with a	EI 120 U/C	
high	Coated Batt.	PVC Pipe 100mm Ø 4.2mm - 7.4mm Wall thickness.	100mm PipeBloc PCP Collars		separation.	80mm Pig Tail Screw.	I		
		PVC Pipe 110mm Ø 4.2mm - 7.4mm Wall thickness.	110mm PipeBloc PCP Collars			on both sides of wall with a 80mm Pig Tail			
		PVC Pipe 125mm Ø 6mm Wall thick- ness.	125mm PipeBloc PCP Collars						
		PVC Pipe 140mm Ø 6.1mm - 7.5mm Wall thickness.	140mm PipeBloc PCP Collars						
		PVC Pipe 160mm Ø 6.2mm - 9.5mm Wall thickness.	160mm PipeBloc PCP Collars						











ETA 15-0489 CE-1121-CPR-JA5080

Р	PipeBloc PCP Collars, face fixed onto Stopseal Batt in Flexible Wall with a minimum thickness of 100mm PVC-U & PVC-C Pipes									
Aperture Size	Seal Composition	Services	Collar Reference	Capping	Penetration Formation	Collar Fixing	Classification			
		PVC Pipe 32mm Ø 1.8mm Wall thick- ness.	32mm PipeBloc PCP Collars							
		PVC Pipe 40mm Ø 1.8mm Wall thick- ness.	40mm PipeBloc PCP Collars							
		PVC Pipe 50mm Ø 1.8mm Wall thick- ness.	50mm PipeBloc PCP Collars							
		PVC Pipe 55mm Ø 2.3mm - 3mm Wall thickness.	55mm PipeBloc PCP Collars							
		PVC Pipe 63mm Ø 2.3mm - 3mm Wall thickness.	63mm PipeBloc PCP Collars			Fixing Fixed on both sides of				
		PVC Pipe 75mm Ø 3.1mm - 4.8mm Wall thickness.	75mm PipeBloc PCP Collars							
750mm	Pattress installation	PVC Pipe 82mm Ø 3.1mm - 4.8mm Wall thickness.	82mm PipeBloc PCP Collars		Cluster	on both				
wide by 1200mm	of 50mm thick 140kg/	PVC Pipe 90mm Ø 4.2mm - 7.4mm Wall thickness.	90mm PipeBloc PCP Collars	U/C	Formation of Pipes with Omm	on both sides of wall with EI 120 U/C a 80mm Pig Tail				
high	m ³ Stopseal Coated Batt.	PVC Pipe 100mm Ø 4.2mm - 7.4mm Wall thickness.	100mm PipeBloc PCP Collars	s	separation.					
		PVC Pipe 110mm Ø 4.2mm - 7.4mm Wall thickness.	110mm PipeBloc PCP Collars							
		PVC Pipe 125mm Ø 6mm Wall thick- ness.	125mm PipeBloc PCP Collars							
		PVC Pipe 140mm Ø 6.1mm - 7.5mm Wall thickness.	140mm PipeBloc PCP Collars							
		PVC Pipe 160mm Ø 6.2mm - 9.5mm Wall thickness.	160mm PipeBloc PCP Collars							

Extended Scope of Works

ETA 15-0489 CE-1121-CPR-JA5080

Direct field of application - DiAP and Extended Field of Application- EXAP

DiAP and EXAP rules are an output from European harmonization of fire testing methods, classifications and product standards where applicable. At a national level, experienced persons or fire test organisations have previously provided assessments of expected performance based on expert judgement and opinion, however these rules allow interpretation through the specific EN 1366 test standard.

DiAP and EXAP rules are provided in the EN 1366 and EN 15882 test standards series. They are derived from information obtained from tests carried out in accordance with relevant EN 1366 tests at recognised laboratories in Europe. The test results achieved by a particular design may be directly applied to a limited number of variations without recourse to expert advice, providing the design remains substantially as tested. EXAPs shall be based on primary test evidence to a specific part of the EN 1366 series and may be supplemented by appropriate test evidence generated from other sources, or other relevant historical data. The EXAP rules conside changes in the tested design beyond the scope of direct application and may also consider variations to the tested design.

Direct field of application - DiAP

Fire Stopping systems of this type are often complicated by extensive changes in modern buildings and their influence on the fire hazard should be considered carefully. The fire hazard can be reduced by providing penetration seals at the points where the services pass through fire separating elements (walls/floors).

The impact of fire on a construction or service system can vary considerably. A strict scientific approach to the problem of adequate testing of a sealing system would, therefore, be to design a series of tests each of which corresponds to a specified fire situation and arrangement. However, such an approach would probably fail due to its economic consequences, as tests of this type are very timeconsuming and costly. The method of test described in the EN 1366 series has therefore been designed with the intention of covering a wide range of fire situations in a minimum of tests. To allow a wider field of application, standard configurations are defined on the basis of general experience and historic data wherever possible. As frequently a number of influencing parameters was considered when defining the standard configurations, not all of which may be addressed explicitly in the field of direct application rules (e.g. metalscreen of cables). To allow nevertheless flexibility a modular approach was taken as far as possible so that various combinations of standard configuration elements can be used to fit the needs of the user.

Where a nonstandard configuration was used, the field of application is restricted to what was tested, however the field of direct application rules given in the various parts of the EN 1366 series may be applied, subject to deviating rules given in the annexes of each part. Rules cover supporting construction, orientation, penetrating services, service supports, penetration seal size, distances and overall configurations of penetration seal materials and services to be included.

Extended Field of Application- EXAP

The purpose EXAP document is to provide the principles and guidance for the preparation of extended application documents for penetration sealing systems tested in accordance with the EN 1366 and EN 15882 series. The field of the extended application document is additional to the direct field of application given within the relevant part of EN 1366 and may be applied to or based on a single test, or a number of tests, which provide the relevant information for the formulation of an extended application.


There are a number of practical limitations on the size and design of elements that can be tested by the standard methods of fire resistance test. When these elements are required to be larger, or are of a modified design, there is a necessity to be able to confirm their performance, without the ability of being able to test them. To achieve this, extended application documents for the various elements are used.


Due to the diverse nature of materials and constructions used to seal openings in fire resistant separating elements it has been necessary to separate the extended application principles into generic seal types within the specific EXAP EN 15882 series. Often more than one variation is to be incorporated, should this be the case the overall effect shall be considered. Principles common to all generic seal types are given in the EXAP and rules for each specific generic seal type are given. The Annex provide rules for the application of test results and provides information relating to the extended application of those test results on for service penetrations.

Variables for each seal type, which require consideration included are as follows:

- 1) Separating element;
- Type of service;
- 3) Size of service;
- 4) Seal size and configuration
- 5) Material changes (components or formulation) comparison test approach, reduced test program
- 6) Orientation
- 7) Penetration seals at the head of walls (like a linear joint) consider the issue of movement
- 8) Penetration seals at slab edges (like a linear joint) consider the issue of movement
- 9) Distances of penetration seals to other openings in the separating element e.g. doors



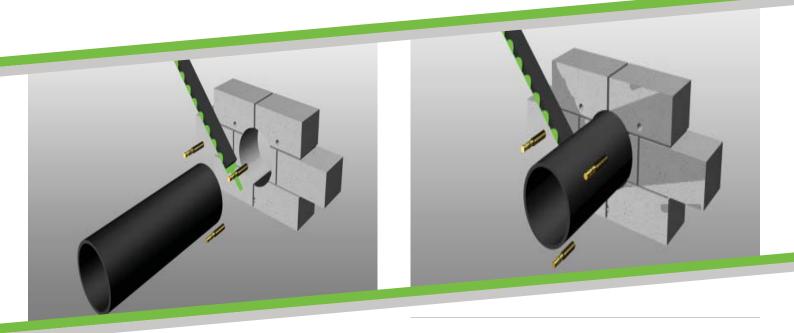

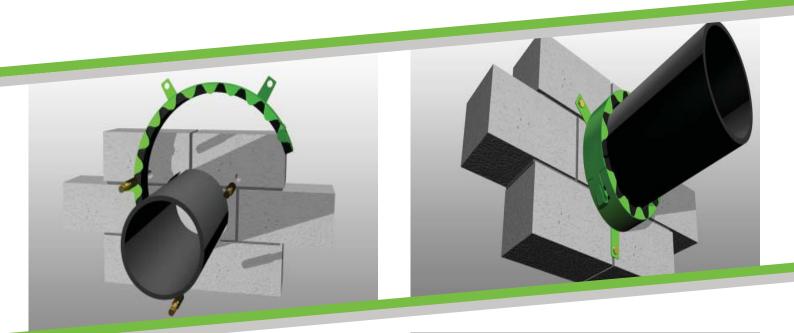

FSi has Technical Representatives who provide assistance in the selection and specification of FSi products. For more information, specification and technical advice please call our Head Office on Tel: +44 (0) 1530 515130. Guarantee / Warranty: FSi products are manufactured to rigid standards of quality. Any product which has been applied in accordance with FSi's written instructions and in any application recommended by FSi, but which is proved to be defective in product quality, will be replaced free of charge. No liability can be accepted for the information provided in this document although it is published in good faith and believed to be correct. FSi Limited reserves the right to alter product specifications without prior notice, in line with our Company policy of continuous development and improvement.